


MODULE MRS232/485

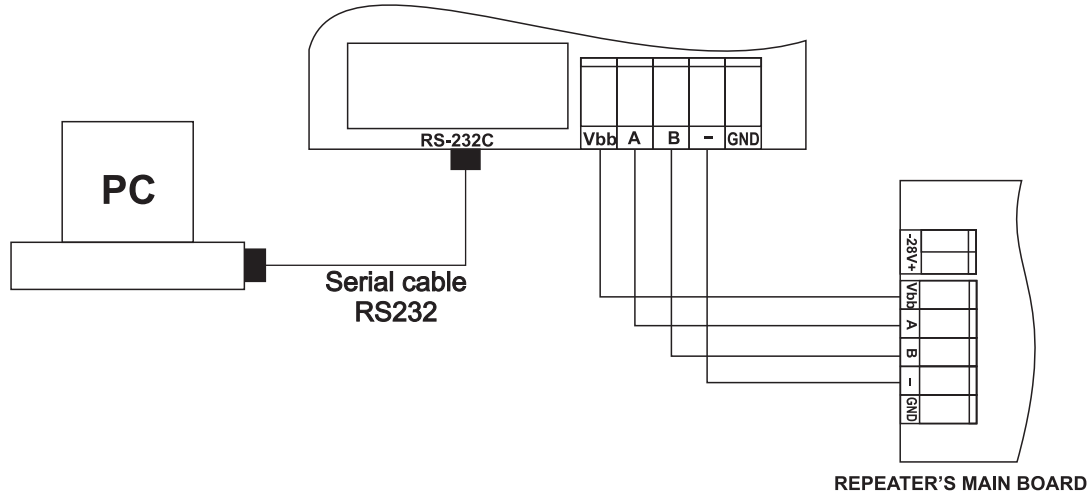

The MRS232/485 module is a device that is part of the conventional fire alarm series Matrix2000. It has a serial port RS232 that is used for connection of the fire alarm panel with a PC running the ViewMatrix monitoring software. The module also provides an RS485 port, for connection with the Matrix2000 repeaters. See schematic above.

The jumper labeled JP2 is used only when the Matrix2000 panel is connected to repeaters. In the event that repeaters are not connected then the jumper JP2 must be left open, otherwise, repeaters connected, JP2 must be closed.